

A Review on Active Reactive Power Droop Control in Cascaded Type Microgrid

Ambikesh Kumar Soni¹ Durgesh Vishwakarma²

M. Tech Scholar, Department of Electrical & Electronics Engg. REC Bhopal (India)¹
Assistant Professor, Department of Electrical & Electronics Engg REC Bhopal (India)²

ABSTRACT

Distributed generation units incorporating power electronics are becoming popular owing to their zero emission features. The most important elements to evaluate the successful use and flexibility of microgrids are the control as well as coordination of such generating units. The present report operates a space vector PWM technically controlled distribution unit linked to the series with steady power sharing. The synchronisation as well as power balancing of dispersed generating devices constitutes two major problems in cascaded-type microgrids that require immediate response. To that aim, in this research, an f-P/Q drop control is suggested and its stability is also examined. This suggested drop-control is capable of independently achieving power balance under resistive and resistive loads.

Key Words: Cascaded-type microgrid, droop control, power balance.

1.INTRODUCTION

Micro grid provides an efficient method for securely integrating dispersed energy resources that may be used in both grid-connected and insular modes. By its configuration, the microgrid may be split into two categories: parallel as well as cascaded. The former was thoroughly examined. The droop control is being used extensively to achieve parallel type microgrid power sharing as well as extended to additional applications that include a storage system's state-of-charge (SOC) balancing, a cost-effective distribution system for distributed generators (DGs) and a PWM system drive system for droop control. Furthermore, the cascaded microgrid type is a novel one just introduced. [1]

Initially, the cascaded converter is used on multilayer inverters and first expanded to microgrid applications for greater voltage and better usage. The cascaded form is extremely useful in particular for PV grid linked application and battery management. The power balance of all

modules is important in an islanded cascaded-type microgrid. In order to establish power balance, a reverse drop control is suggested, which may also be utilised in the DC microgrid. For the AC microgrid, a novel inverse power factor drop control is suggested for power balancing. The technique is nevertheless only relevant in instances of resistive-inductive loads by a researcher. But this technique is utilised for inductive resistive loads as well as capacitive resistive loads. [2]

1.1. MICROGRID

The design of the electricity system is evolving as big, centrally linked power plants are converted into horizontally distributed, small power generation and distribution system via vertical networks.

The motivating force for this change is climate pressure, fossil fuel prices and energy security. Conventional high-capacity power plants are powered by highly polluting fossil fuels and contribute significantly to greenhouse gas emissions. Therefore, because of the cheap cost and environmental advantages of renewable DGs such as solar photovoltaic and fuel cells, the battery storage system is quickly expanding. [3]

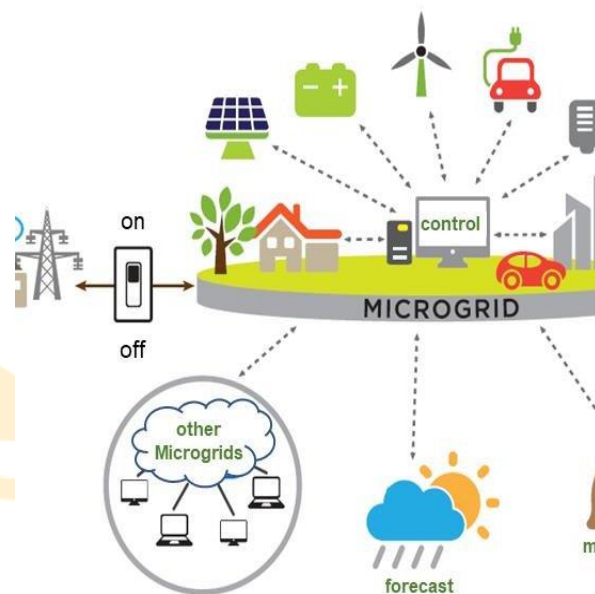


Figure 1 Microgrid concept

In addition, for the efficient and flexible use of these DGs the idea of microgrid has been suggested. By definition, a microgrid is a collection of linked loads and DGs which have well defined electrical frontiers. It may be linked or disconnected from the grid so that it can function in both the grid and insular mode, providing a more flexible and dependable energy system. Whilst micro-grids enhance the overall supply system's dependability and efficiency, voltage and current regulation and energy balancing in such a hybrid system are the difficult jobs because renewable DGs, such as wind and solar, are naturally intermittent.

The literature has a variety of microgrid definitions and functional categorization systems. A wide definition created by the

Microgrid Exchange Group for the U.S. Department of Energy, an ad hoc team of research and implementation specialists, includes the following: [4]

“A microgrid is a group of interconnected loads and distributed energy resources within clearly defined electrical boundaries that acts as a single controllable entity with respect to the grid. A microgrid can connect and disconnect from the grid to enable it to operate in both grid-connected or island mode.”

This description comprises three requirements: 1) to allow the distribution system component consisting of a microgrid to be identified as distinct from the rest of the system; 2) to control the resources connected to the micro-Grid in conjunction instead of with distant resources; as well as 3) to enable the microgrid to work regardless of whether it is linked to the larger grip. The term makes no reference to the size or kind of technologies that may or should be utilised for the distributed energy resources. [5]

1.2. CASCADED-TYPE MICROGRID

MICROGRID provides an efficient solution for the reliable integration of dispersed power resources in grid-related and insular modes. Through its configuration, the microgrid may be

divided into two main categories: parallel and cascaded type.

Originally, the cascaded converter is used on multilayer inverters and first expanded to microgrid applications for greater voltage and better usage. The cascaded form is extremely useful in particular for PV grid linked application and battery management. The power balance of all modules is important in an islanded cascaded-type microgrid. In order to establish power balance, a reverse drop control is suggested, which may also be utilised in the DC microgrid. For the AC microgrid, a novel inverse power factor drop control is suggested for power balancing. However, this technique applies exclusively to resistive-inductive load situations.[6]

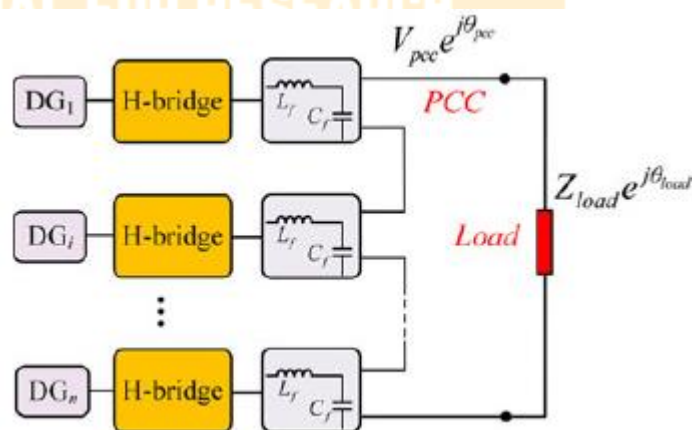


Figure 2 Structure of islanded cascaded-type microgrid

This letter offers an f-P/Q droop control method in the cascaded type microgrid to

solve the constraint. Frequency synchronisation and the power sharing across all DGs under resistive and resistive loads may be accomplished autonomously. The stability of the system suggested is theoretically shown. [7]

2.LITERATURE REVIEW

Tejas & Vaikund In this article, energy management system control (EMS) for a photovoltaic microgrid (PV)-based distribution generating system (DG) is provided. In improving the performance and efficiency of the distribution system network, the DG units and energy storage devices play a crucial role. Hill Climbing method is utilised as MPPT algorithm for extracting maximum power produced from photovoltaic source and augmented by battery-based energy storage systems in overcast circumstances.

Masoud Worldwide electricity networks are transitioning progressively from traditional fossil-fue producing units to green energy sources. The environmental and economic concerns are the reason for this shift. Moreover, current electricity systems are overloaded every day since the population is steadily growing and thus transformers, transmission and distribution lines overburdened. Although renewable energy sources provide overwhelming

benefits, few significant problems are involved. Injecting DGs into the existing power system, for example, causing discrepancies between generated power and the associated load, disturbing the system's balance and causing undesired oscillations and overshoots in voltage and frequency.

Sirviö Microgrid operations are difficult because they include many players and manage a wide range of active and intelligent resources or devices. Management functions, such as frequency control or isolation, are specified in the idea of the microgrid, although certain functions may not be required depending on the application. A thorough case study is needed to evaluate the necessary functionalities for network operations and to see the interactions among the players running a specific microgrid. This article provides the case modelling approach for microgrid management at a more practical level from an abstract or conceptual one. By using case studies, prospective entities may be identified where real solutions need to be developed or improved.

Srivani In order to establish an autonomous power balancing in a cascaded microspace system, this research primarily focuses on the f-P/Q drop control. The synchronisation and power balancing of distributed generators

constitute two new micro grid issues that need immediate solutions in a cascaded manner. The obvious advantage is to expand the programme with regard to the management of the reverse power factor decrease. Finally, the simulation results show that the suggested approach is feasible. The DGs are replaced with extended sources of energy (PV, super condensers, wind). For this expansion, use of PV as a DG. It knows the proper real power and reactive energy balance independently with resistive and resistive loads. DGs are replaced by distributed energy sources.

Nurul Farhana Abdul Hamid, Muhammad Alleef This article covers the design and modelling of single-phase inverters utilising unipolar modulation of the sinusoidal pulse width (SPWM). The circuit was developed and simulated using the software Matlab/Simulink. A switch was employed to the Metal Oxide Semiconductor Field Effect Transistor (MOSFET).

3.DISTRIBUTED GENERATORS

There are two different types of generation technologies applicable for microgrid design such as renewable distribution generation (solar thermal, photovoltaic (PV), wind, fuel cell, CHP, hydro, biomass, biogas, etc.), and non-renewable

distribution generation (diesel engine, stream turbine, gas engine, induction and synchronous generators, etc.). The usage of wind energy has quickly grown by approximately 30 percent per year worldwide and has become an important resource for microgrid electricity, along with solar energy. These developing technologies and well-established generating technologies are well-known and this research includes an in-depth examination of these generation systems.[1]

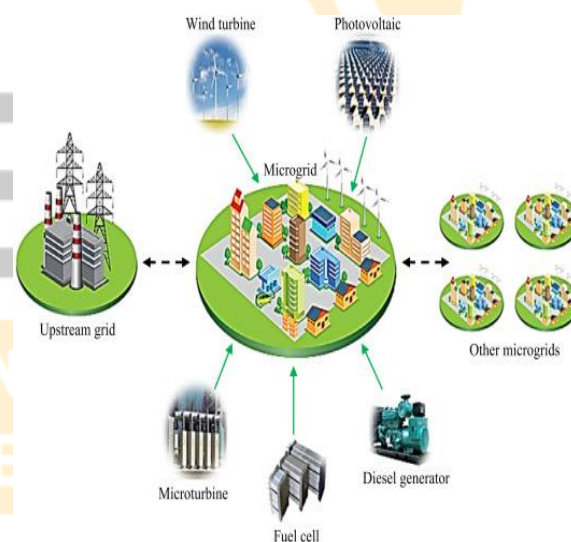


Figure 3 Distributed generation and microgrids

The production of electricity from renewable energy distribution is difficult since it is intermittent power sources. The power output relies largely on solar energy, since virtually every type of renewable energy supply has to do with a solar power system. Building a power grid

with no non-renewable DGs is thus hazardous in terms of dependability. More than 80 percent of the U.S. population, comprising 37 states, has, according to a Resnick Institute study, passed renewables requirements including up to 33 percent of the energy supply projected to consumers by 2020. Moreover, some 675 billion dollars will be spent in the U.S. to build distribution infrastructure by 2030. As a result, each state stepped up its goal of standard distribution, production and generation of renewable energy. Many governments have already begun major electrification efforts with increasing demand and growing dependability problems. [9]

4.DROOP CONTROLLER METHOD

It is autonomous approach for controlling the frequency and voltage amplitude of the generator connected to micro grid. It takes the advantages that real power controls frequency and that the reactive power controls the voltage. The power sharing can be done by the droop control method by using the real power controller and reactive power controller. [37]

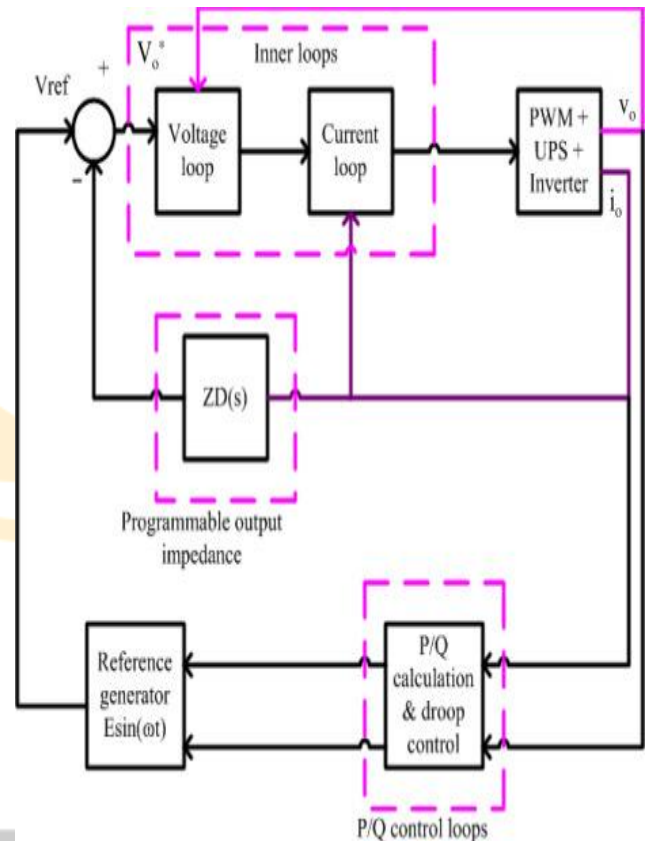


Figure 3 Droop Controller Technique

The expression defining the real power frequency control of droop characteristic are expressed as

$$\omega(t) = \omega^* - (Pj^* - (t)) \quad (1)$$

$$\beta j = \omega^* - \omega_{min} / Pj^* - Pj,max$$

Where (t) is the actual active power output of the Distributed generation system and βj is the slope of the P - ω droop characteristics

Where (t) is reactive power output and is the slope of reactive - voltage droop characteristics.

The total harmonic distortion (THD) at the point of common coupling are minimized for the stand-alone and system relating the problem on reactive power sharing. The

capacitive virtual impedance loop is used to control the voltage harmonics which occurs at PCC. In grid connected mode, the current control loop is applied to flow the active and reactive power for the power grid and frequency operation. In autonomous mode, power converters are used for operation in three sub-modes like convection droop mode, PCS mode and synchronization mode. The (V_g/V_{dc}) droop control which provides the dc link voltage at inverter output to maintain the power in micro grid. P-V_g droop control maintains the voltage limiting the constant power band. The hierarchical control consist voltage droop control and impedance control loop for VSI based MG system. These maintaining the phase angle and voltage reference of real power and reactive power. Virtual inductor is used for inverter output of power electronic devices connect to DG system which disconnect the coupling between real and reactive power. An enhanced droop control based on virtual impedance for controlling the frequency to minimize the reactive power load, unbalanced power load and distorted harmonic power load issues.[2]

Transient droop controller is used to minimize the transient voltage. Virtual inductance are connected in this controlled to avoids the harmonic voltage in grids. The droop control provides the active and

reactive power influence on voltage and frequency. It supply the smooth voltage and frequency control but is mostly dependent on the specification between inverter connected distribution generation and load.[3]

5.CONCLUSION

SVPWM Technics Module has less active power rips and less THD in the output voltage. It achieves a precise real-power and reactive-power balance autonomously under resistive and resistive loads. In the meanwhile, the ac bus voltage is adjustable. This article proposes a novel way to get a precise load sharing ratio across series inverters in island microgrids. In this research, the voltage drop pitch is adjusted to offset the voltage drop in line impedances by utilising communication connections. The technique ensures precise power sharing even when the connection is interrupted.

6.REFERENCES

- [1] R. N. Tejas and H. Vaikund, "Design and Control of PV Connected Microgrid," vol. 10, no. 01, pp. 66–72, 2021.
- [2] S. Masoud, A. Altbawi, A. Safawi, B. Mokhtar, and Z. Ahmad, "Enhancement of Microgrid Technologies using Various

Algorithms,” vol. 12, no. 7, pp. 1127–1170, 2021.

[3] K. Sirviö, K. Kauhaniemi, A. A. Memon, and H. Laaksonen, “Functional Analysis of the Microgrid Concept Applied to Case Studies of the Sundom Smart Grid,” 2020.

[4] P. Srivani et al., “AN F-P / Q DROOPCONTROL IN CASCADED TYPE MICROGRID TO ACHIEVE POWER BALANCE UNDER BOTH RESISTIVE-INDUCTIVE AND RESISTIVE- CAPACITIVE LOADS AUTONOMOUSLY,” vol. 7, no. 16, pp. 2704–2712, 2020.

[5] N. S. S. M. Nurul Farhana Abdul Hamid, Muhammad Alleef Abd Jalil, “Design and simulation of single phase inverter using SPWM unipolar technique Design and simulation of single phase inverter using SPWM unipolar technique,” 2020, doi: 10.1088/1742-6596/1432/1/012021.

[6] U. N. Patel and H. H. Patel, “Dynamic Droop Control Method for Islanded Photovoltaic Based Microgrid for Active and Reactive Power Control with Effective Utilization of Distributed Generators,” vol. 9, no. 2, 2019.

[7] J. El Mariachet, J. Matas, H. Mart, M. Li, Y. Guan, and J. M. Guerrero, “A

Power Calculation Algorithm for Single-Phase Droop-Operated-Inverters Considering Linear and Nonlinear Loads HIL-Assessed,” 2019.

[8] A. W. N. Husna, M. A. Roslan, M. H. Mat, and A. Info, “Droop control technique for equal power sharing in islanded microgrid,” vol. 10, no. 1, pp. 530–537, 2019, doi: 10.11591/ijpeds.v10.i1.pp530-537.

[9] S. Tahir, J. Wang, M. H. Baloch, and G. S. Kaloi, “Digital Control Techniques Based on Voltage Source Inverters in Renewable Energy Applications: A Review,” 2018, doi: 10.3390/electronics7020018.

[10] N. K. Yadav, “Power Quality Improvement In Microgrid Using Different Control Techniques,” vol. 6, no. 2, pp. 79–83, 2018.

[11] A. Hirsch, Y. Parag, and J. Guerrero, “Microgrids: A review of technologies, key drivers, and outstanding issues,” *Renew. Sustain. Energy Rev.*, vol. 90, no. March, pp. 402–411, 2018, doi: 10.1016/j.rser.2018.03.040.

[12] S. Haider, G. Li, and K. Wang, “A dual control strategy for power sharing improvement in islanded mode of AC microgrid,” 2018.